



ADDENDUM NO. 1

DATE: December 11, 2020

PROJECT: Gum Springs Water System Improvements – Contract 1
Paint and Repair 50,000-Gal Elevated Water Storage Tank
Arkadelphia, Arkansas

BID DATE: December 17, 2020, 1:00 PM

This Addendum forms a part of the Contract Documents and modifies the original documents provided to Bidders, as noted below. Acknowledge receipt of this Addendum in the space provided in the BID FORM. Failure to do so may subject the Bidder to disqualification.

The Contract Documents for the above Project are hereby amended as follows:

ITEM #1: Specifications – Section 331640 – Tank Mixing System

Replace Part 2.4 - Carbon Steel Pipe and Fittings with the following:

2.4 POLYVINYL CHLORIDE (PVC) PIPE AND FITTINGS

- A. All PVC pipe and PVC fittings shall be a minimum Schedule 80 in accordance with ASTM D1785-83.
- B. PVC pipe and fittings shall be NSF 61 approved for potable water.
- C. PVC pipe compounds shall be in accordance with the standards listed in Section 1.3: reference standards.
- D. PVC solvent and solvent joints shall be in accordance with the standards listed in Section 1.3: reference standards.
- E. Field solvent welding will not be allowed unless approved by the Engineer.
- F. All pipe joints that are to be field connected shall be PVC Van Stone-type flanges. Flange drilling to be in accordance with ANSI B16.1/B16.5.
- G. All fittings shall have the same pressure rating as the pipe unless otherwise noted.


ITEM #2: Appendix C – Tank Details – Sheet No. 1 - Tank Mixing System

Reference Outlet Detail C. Replace 6" with 8" in regard to the inlet pipe and riser pipe diameters.

ITEM #3: Appendix C – Tank Details – Sheet No. 4 – Electrical Details

Replace the Obstruction Light Mount Detail with the following detail, Attached:

A support bracket was added for the dual obstruction light. The support bracket to be painted in accordance with the exterior coating system for the tank as specified in section 099000.

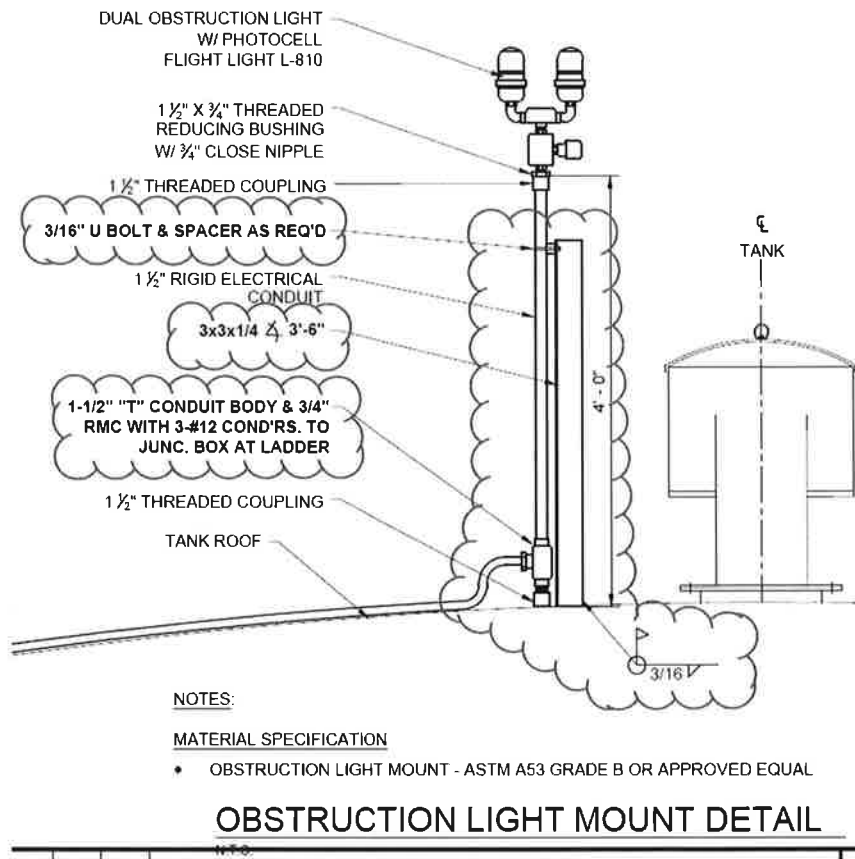

END OF ITEMS

All other provisions of the Contract Documents remain unchanged. Acknowledge receipt of this Addendum on the BID FORM.

CRIST ENGINEERS, INC.

Matthew D. Dunn, P.E.
President