

**ADDENDUM NO. 2****DATE:** July 15, 2026**PROJECT:** Ground Storage Tank
Sardis Water Association**BID DATE:** July 28, 2026, 1:00 PM

This Addendum forms a part of the Contract Documents and modifies the original documents provided to Bidders, as noted below. Acknowledge receipt of this Addendum in the space provided in the BID FORM. Failure to do so may subject the Bidder to disqualification.

The Contract Documents for the above Project are hereby amended as follows:

ITEM #1: BID FORM, ARTICLE 6 – TIME OF COMPLETION

Time of Completion is hereby changed as follows:

Bidder agrees that the Work will be substantially complete within **270 390 calendar days** after the date when the Contract Times commence to run as provided in Paragraph 4.01 of the General Conditions and will be completed and ready for final payment in accordance with Paragraph 15.06 of the General Conditions within **300 420 calendar days** after the date when the Contract Times commence to run.

ITEM #2: Specifications – 221219 – Prestressed Concrete Water Storage Tank

Modify Part 1.2.C.3.i.2 as follows:

A minimum freeboard height of 11 inches above the design liquid level shall be utilized above the design liquid level shall be per ACI 372 and AWWA D110.

ITEM #3: Specifications – 221219 – Prestressed Concrete Water Storage Tank

Modify Part 2.10 A 9 as follows:

“All posts and rails shall be 6061-T6 or 6005-T6, Schedule 80, anodized aluminum pipe.”

ITEM #4: Specifications – 221219 – Prestressed Concrete Water Storage Tank

Add the following to Part 2.10.A.6 as follows:

One OSHA-approved rest platform shall be installed at the midpoint height of the ladder. The rest platform shall be constructed of hot-dipped galvanized steel.

ITEM #5: Drawings – Revised Sheet 7

See revised sheet 7 for the following:

1. Logo Information
2. Undercut requirements per Geotechnical Report
3. Removed 1-foot minimum thickness for tank floor.
4. The rest platform is to be located at the midpoint height of the exterior ladder.

END OF ITEMS

All other provisions of the Contract Documents remain unchanged. Acknowledge receipt of this Addendum on the BID FORM.


CRIST ENGINEERS, INC.



Trevor Voegele, P.E.
Project Manager

COPYRIGHT © 2026 CRIST ENGINEERS, INC.


P:\2026 projects\26004 - sardis water - wst & water line improvements\06 - cad\01 - Civil\Sardis Water Assoc - Plan Set.dwg 7/13/2026 2:21 PM

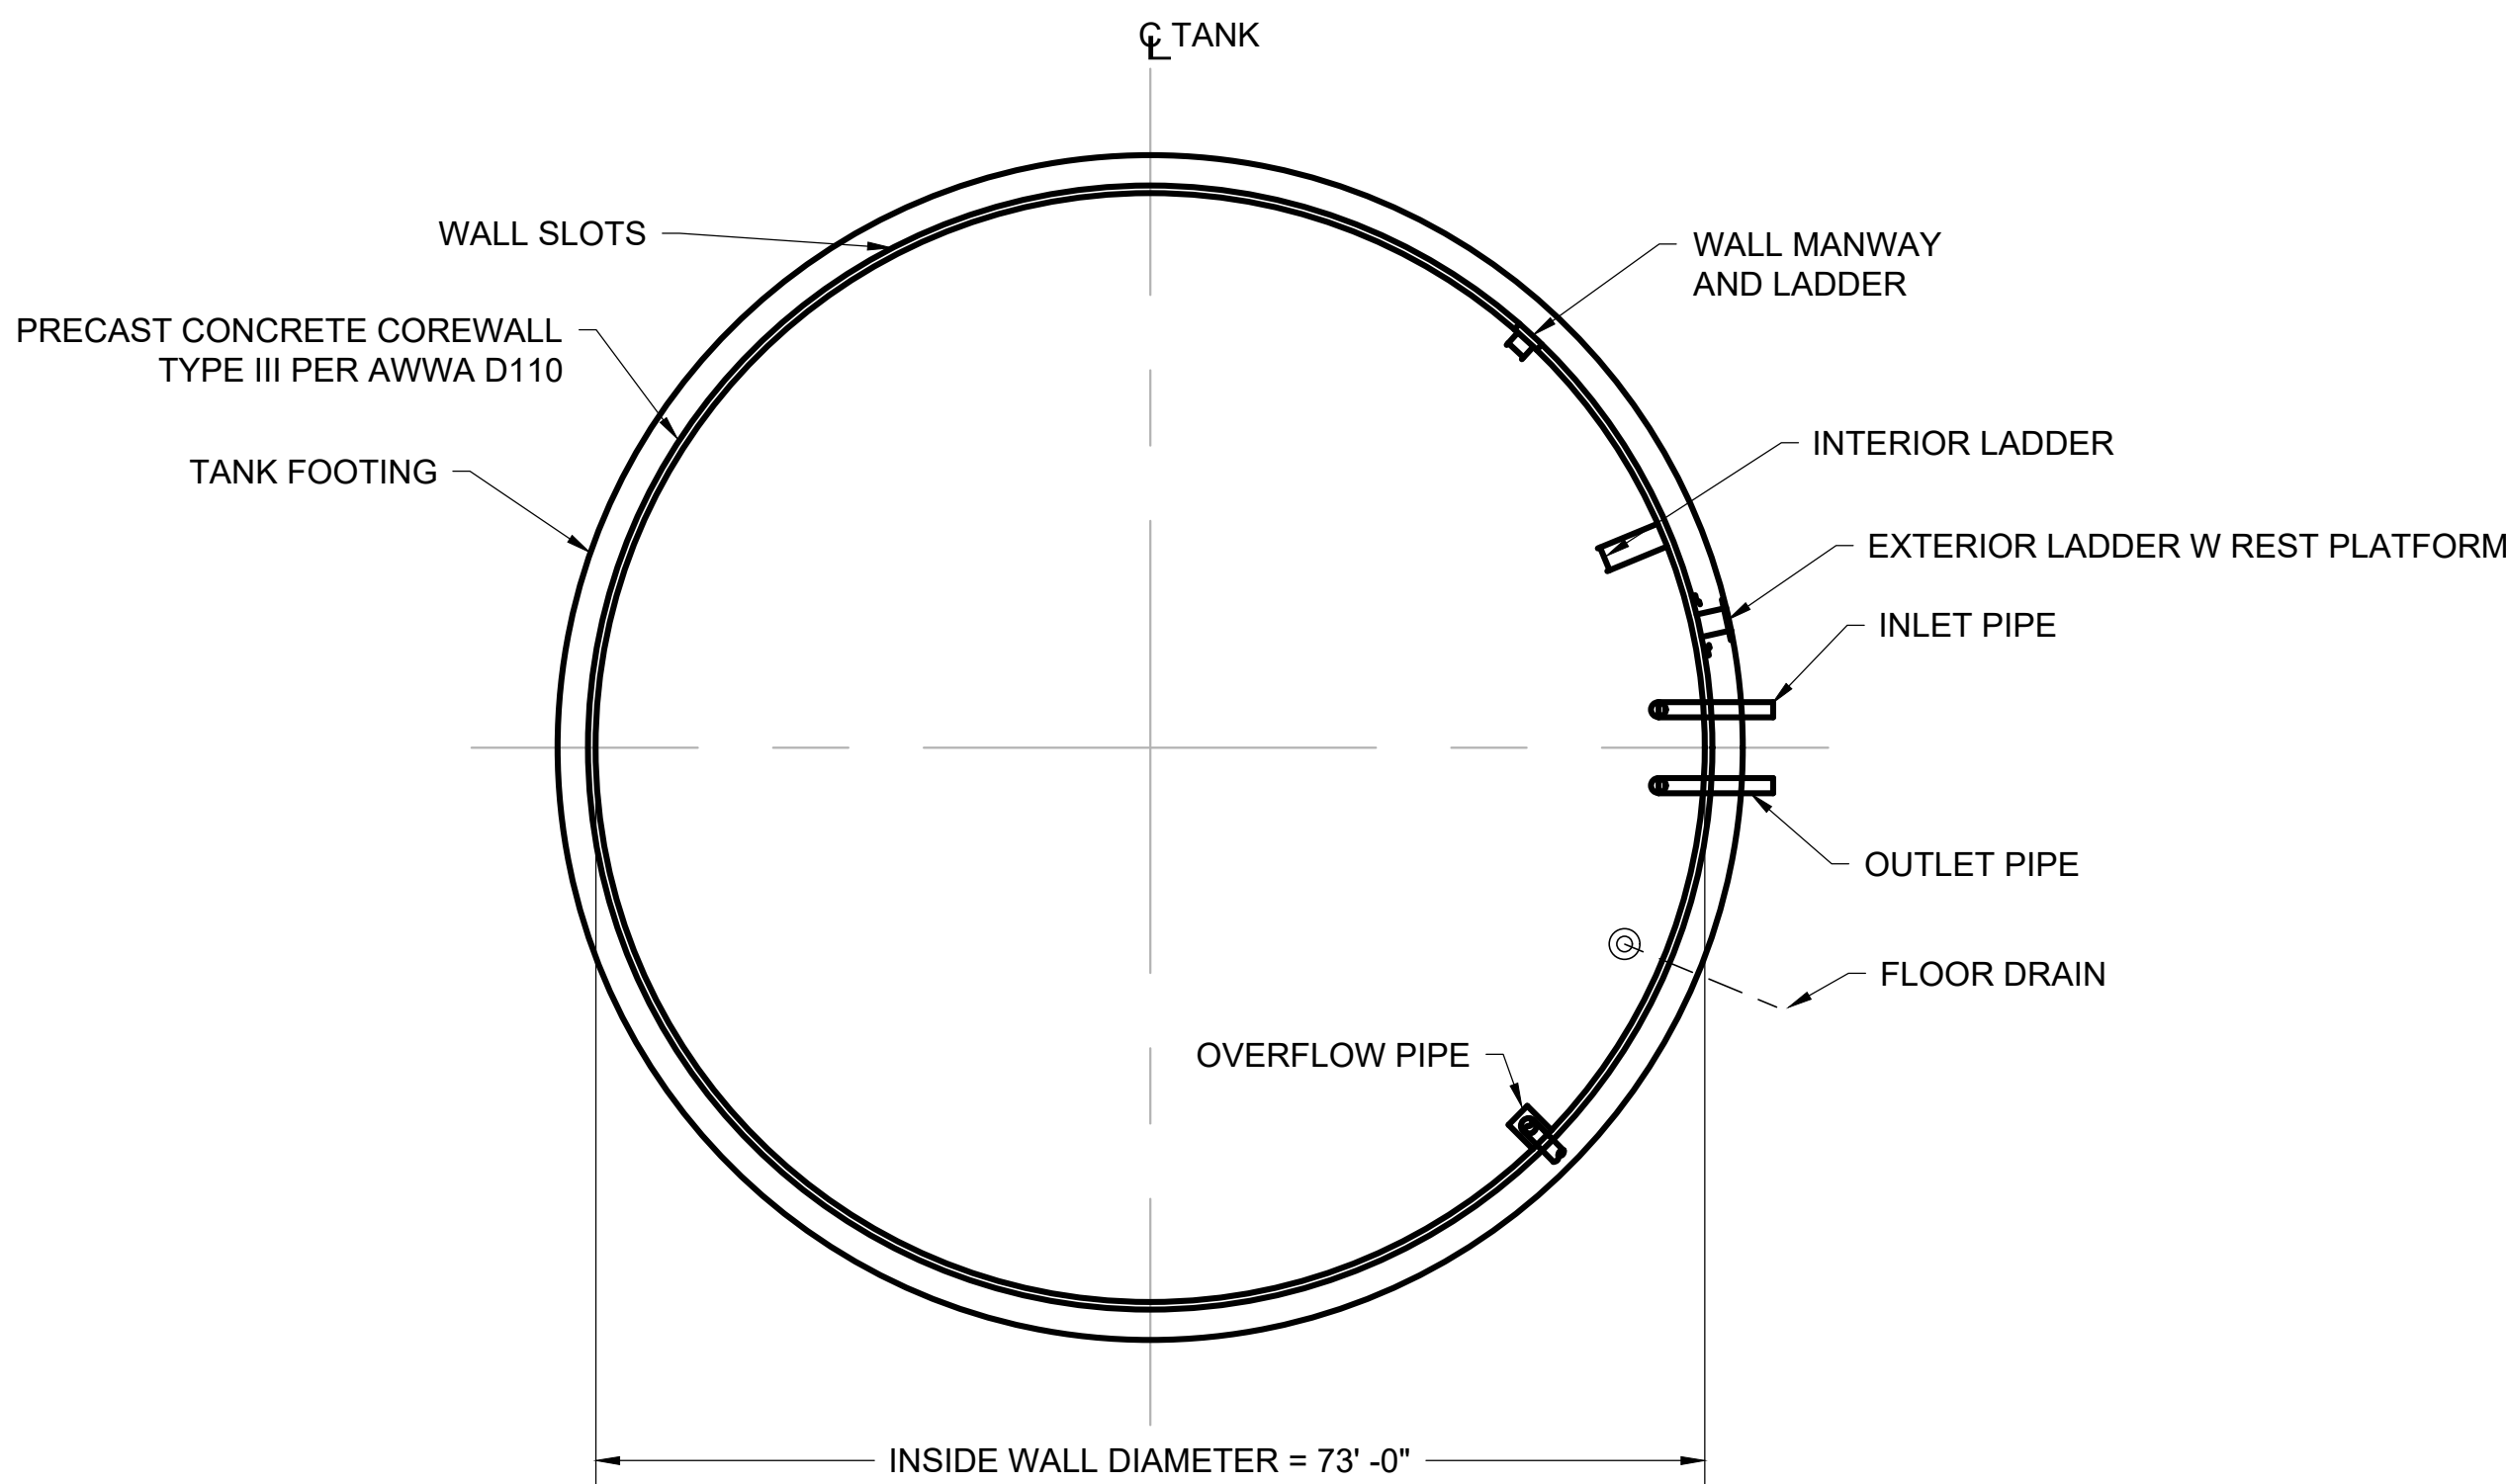

2.35 MG STORAGE TANK
FLOOR PLAN

N.T.S.


A
7

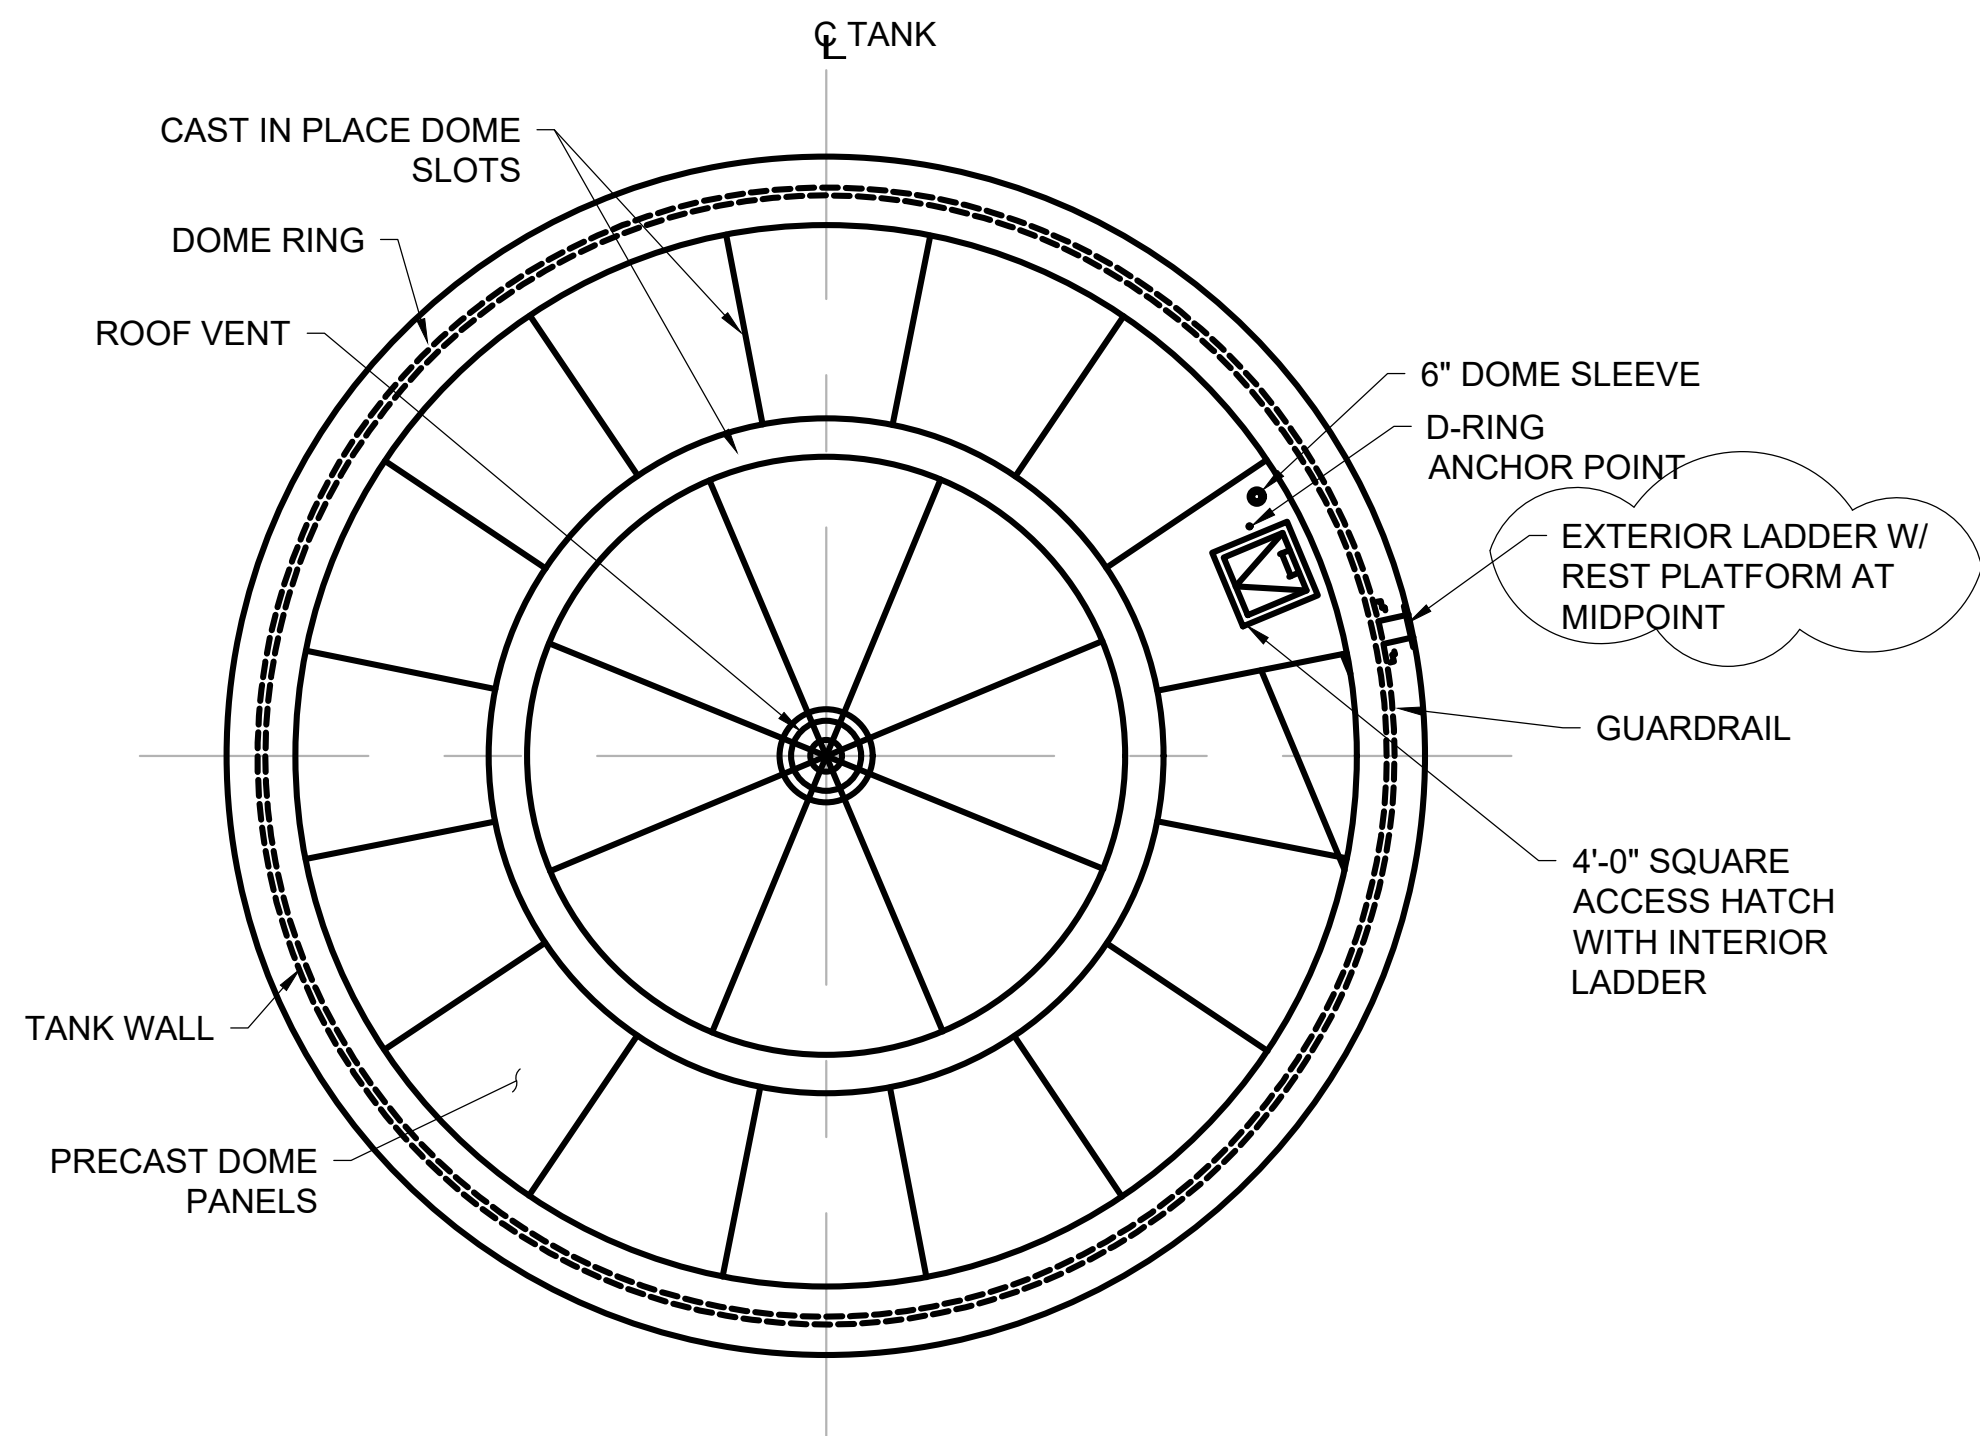

2.35 MG STORAGE TANK
ROOF PLAN

N.T.S.


B
7

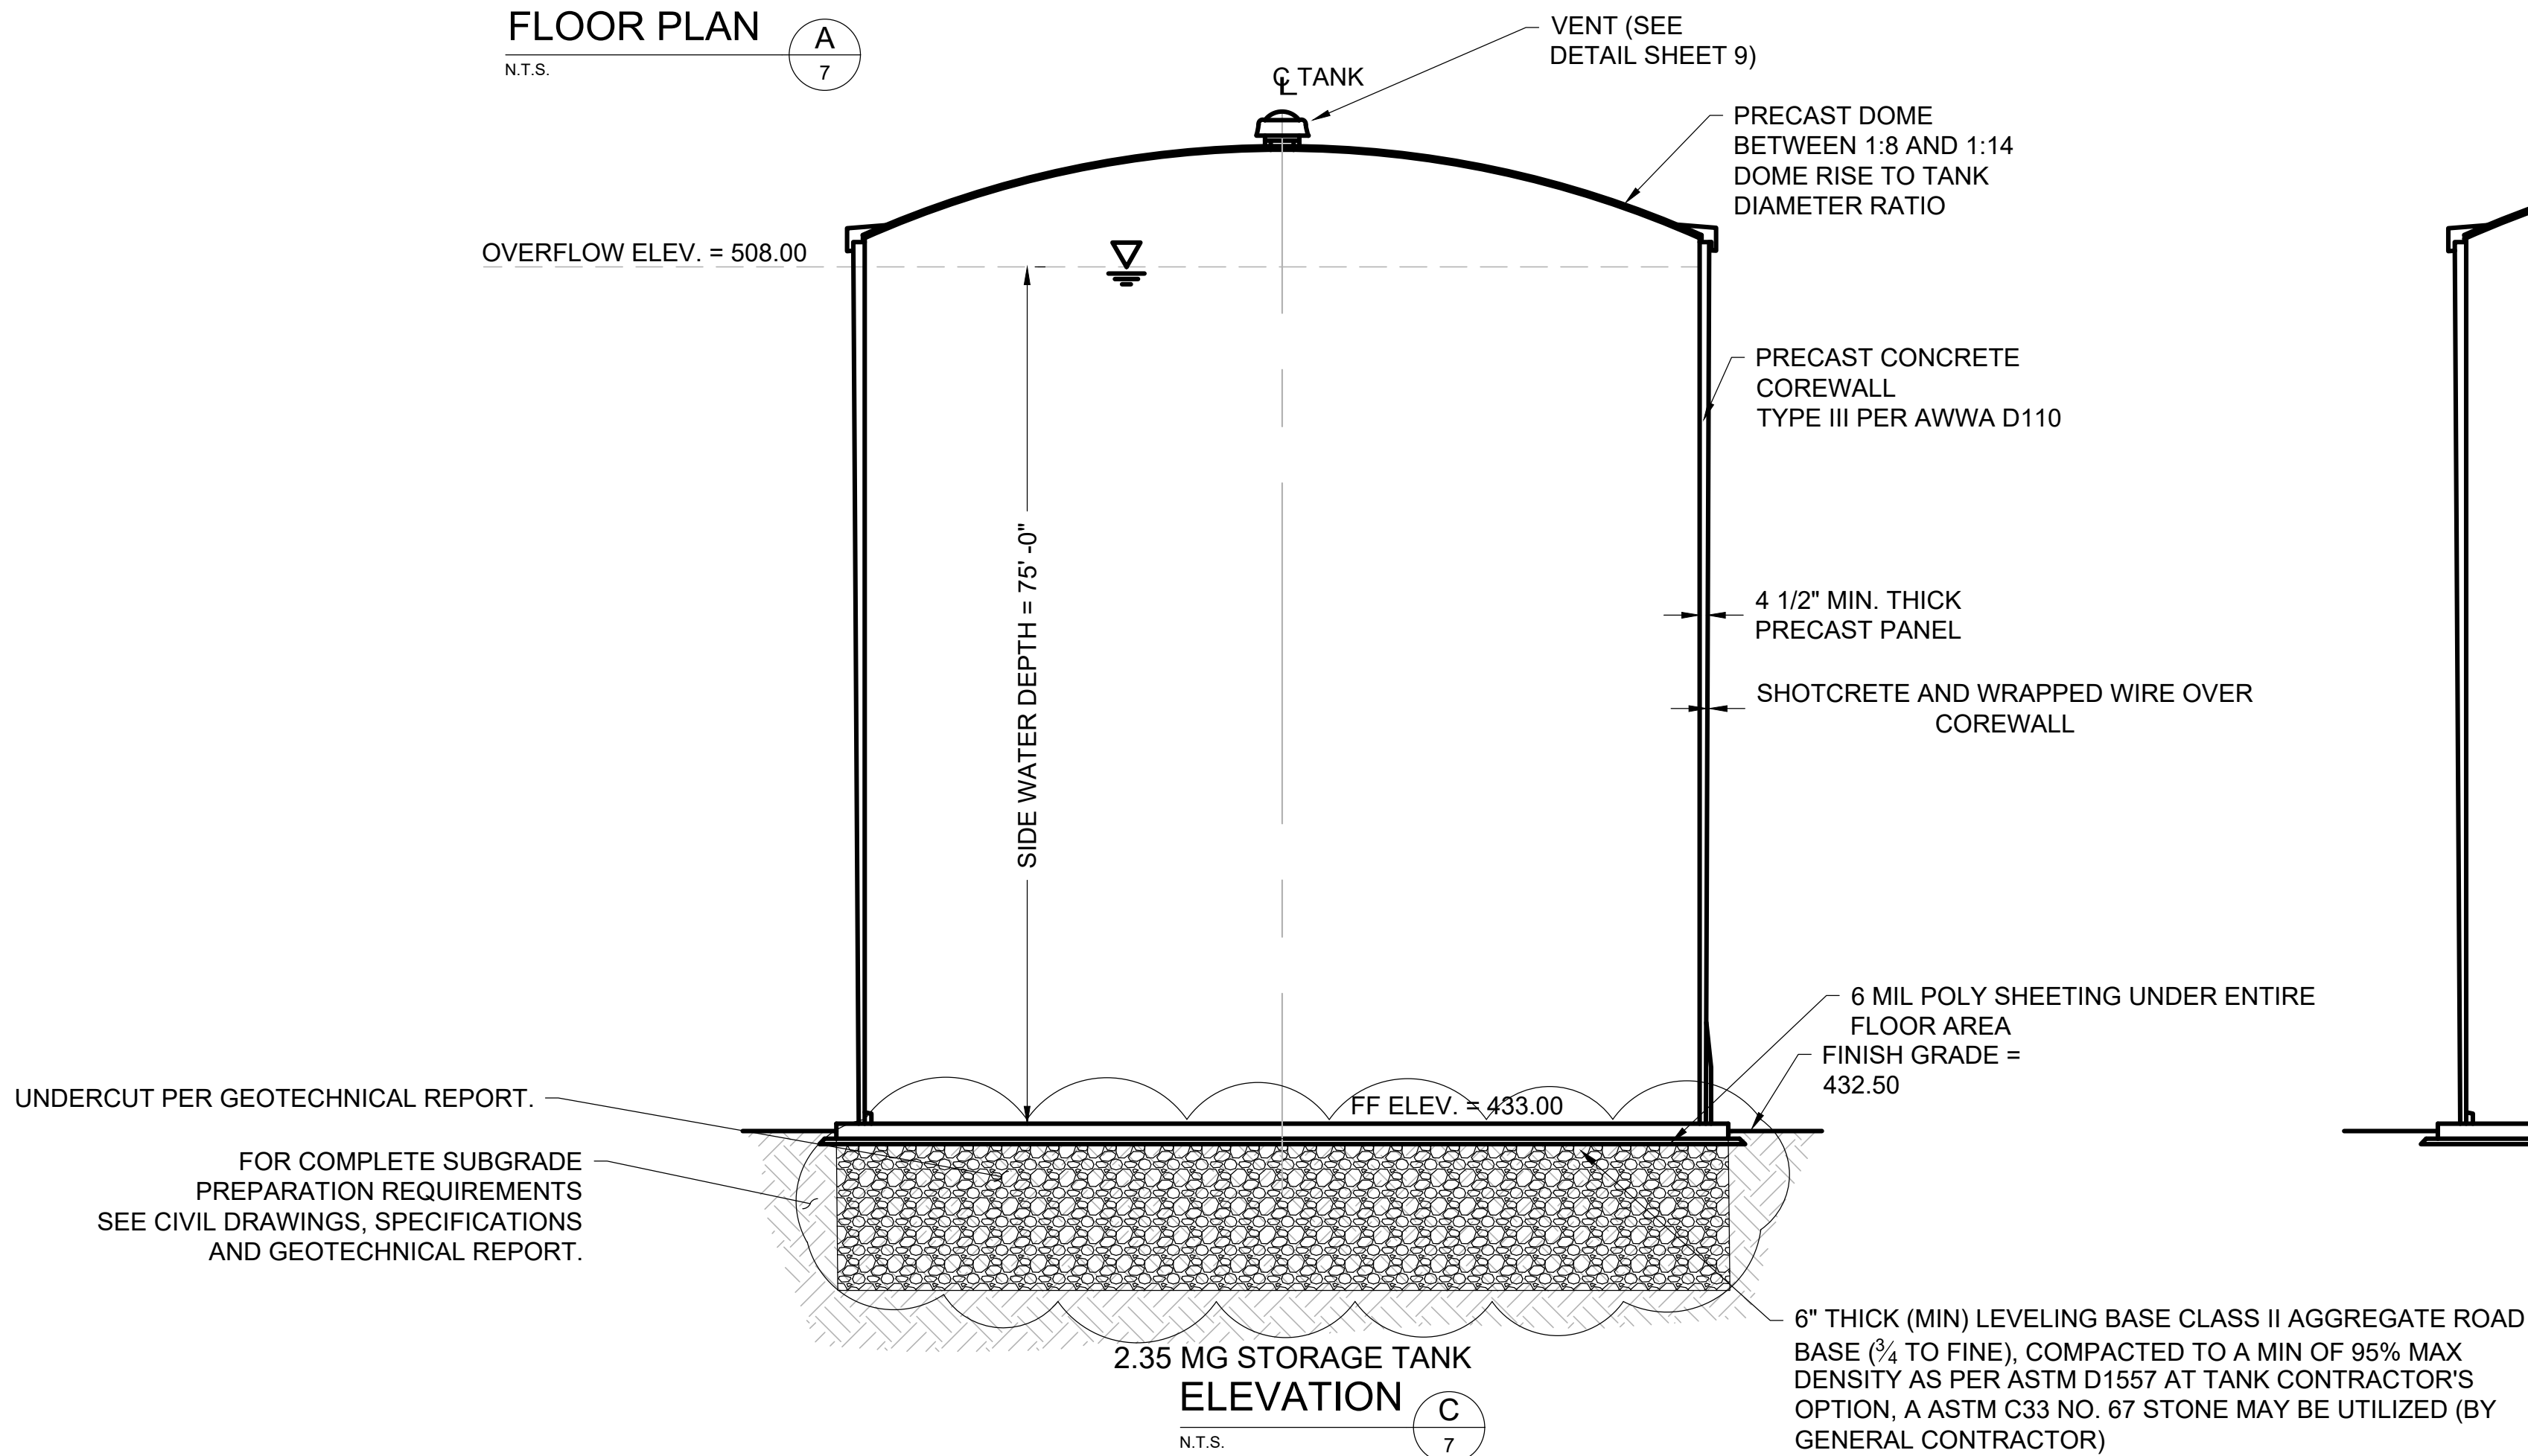

2.35 MG STORAGE TANK
ELEVATION

N.T.S.

C
7


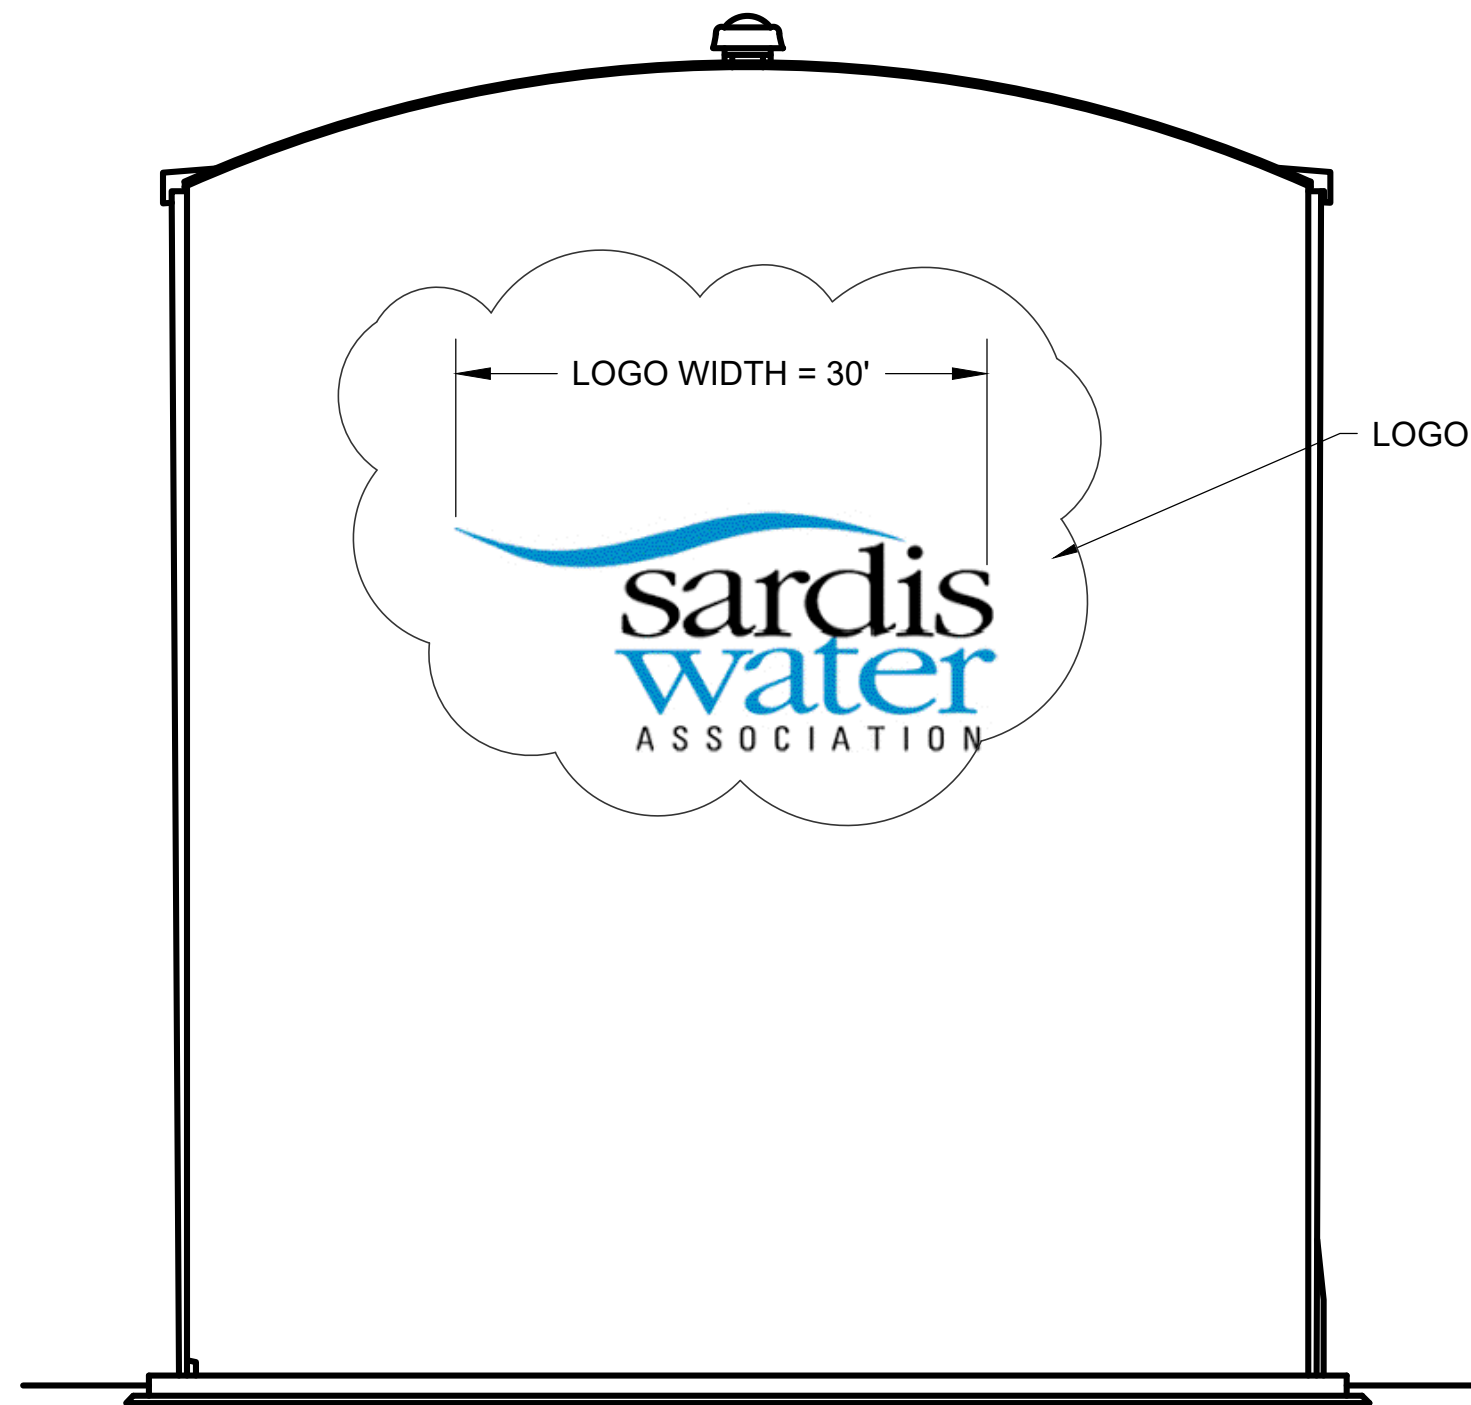


2.35 MG STORAGE TANK
ELEVATION / LOGO

N.T.S.

D
7

REV. NO.	DATE	DRWN	CHKD	REMARKS
1	7/26	TV	MD	ADDENDUM 2

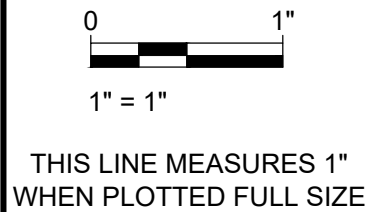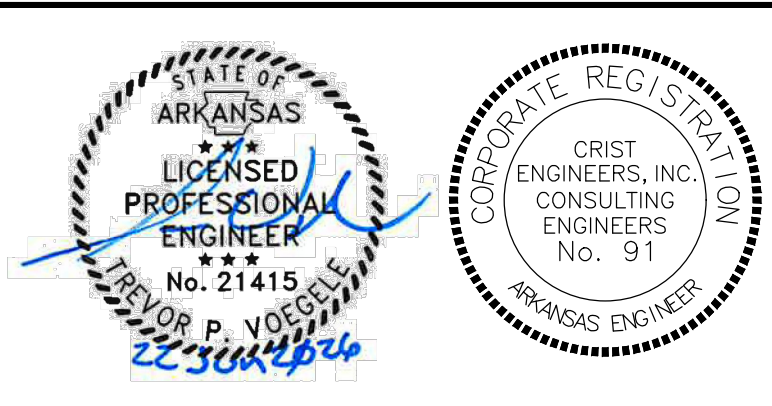

DESIGNED:	TPV
DRAFTED:	JDW
CHECKED:	MDD
DATE:	JUNE 2026



CRIST ENGINEERS, INC.
CONSULTING ENGINEERS

1 EXECUTIVE CENTER COURT
LITTLE ROCK, ARKANSAS 72211
TELEPHONE: (501) 664-1552
FAX: (501) 664-8579
WWW.CRISTENGINEERS.COM

MABELVALE, ARKANSAS
SARDIS WATER ASSOCIATION

BID SET
GROUND STORAGE TANK
TANK PLAN & ELEVATION

JOB NO.	26004
SHEET NO.	7